


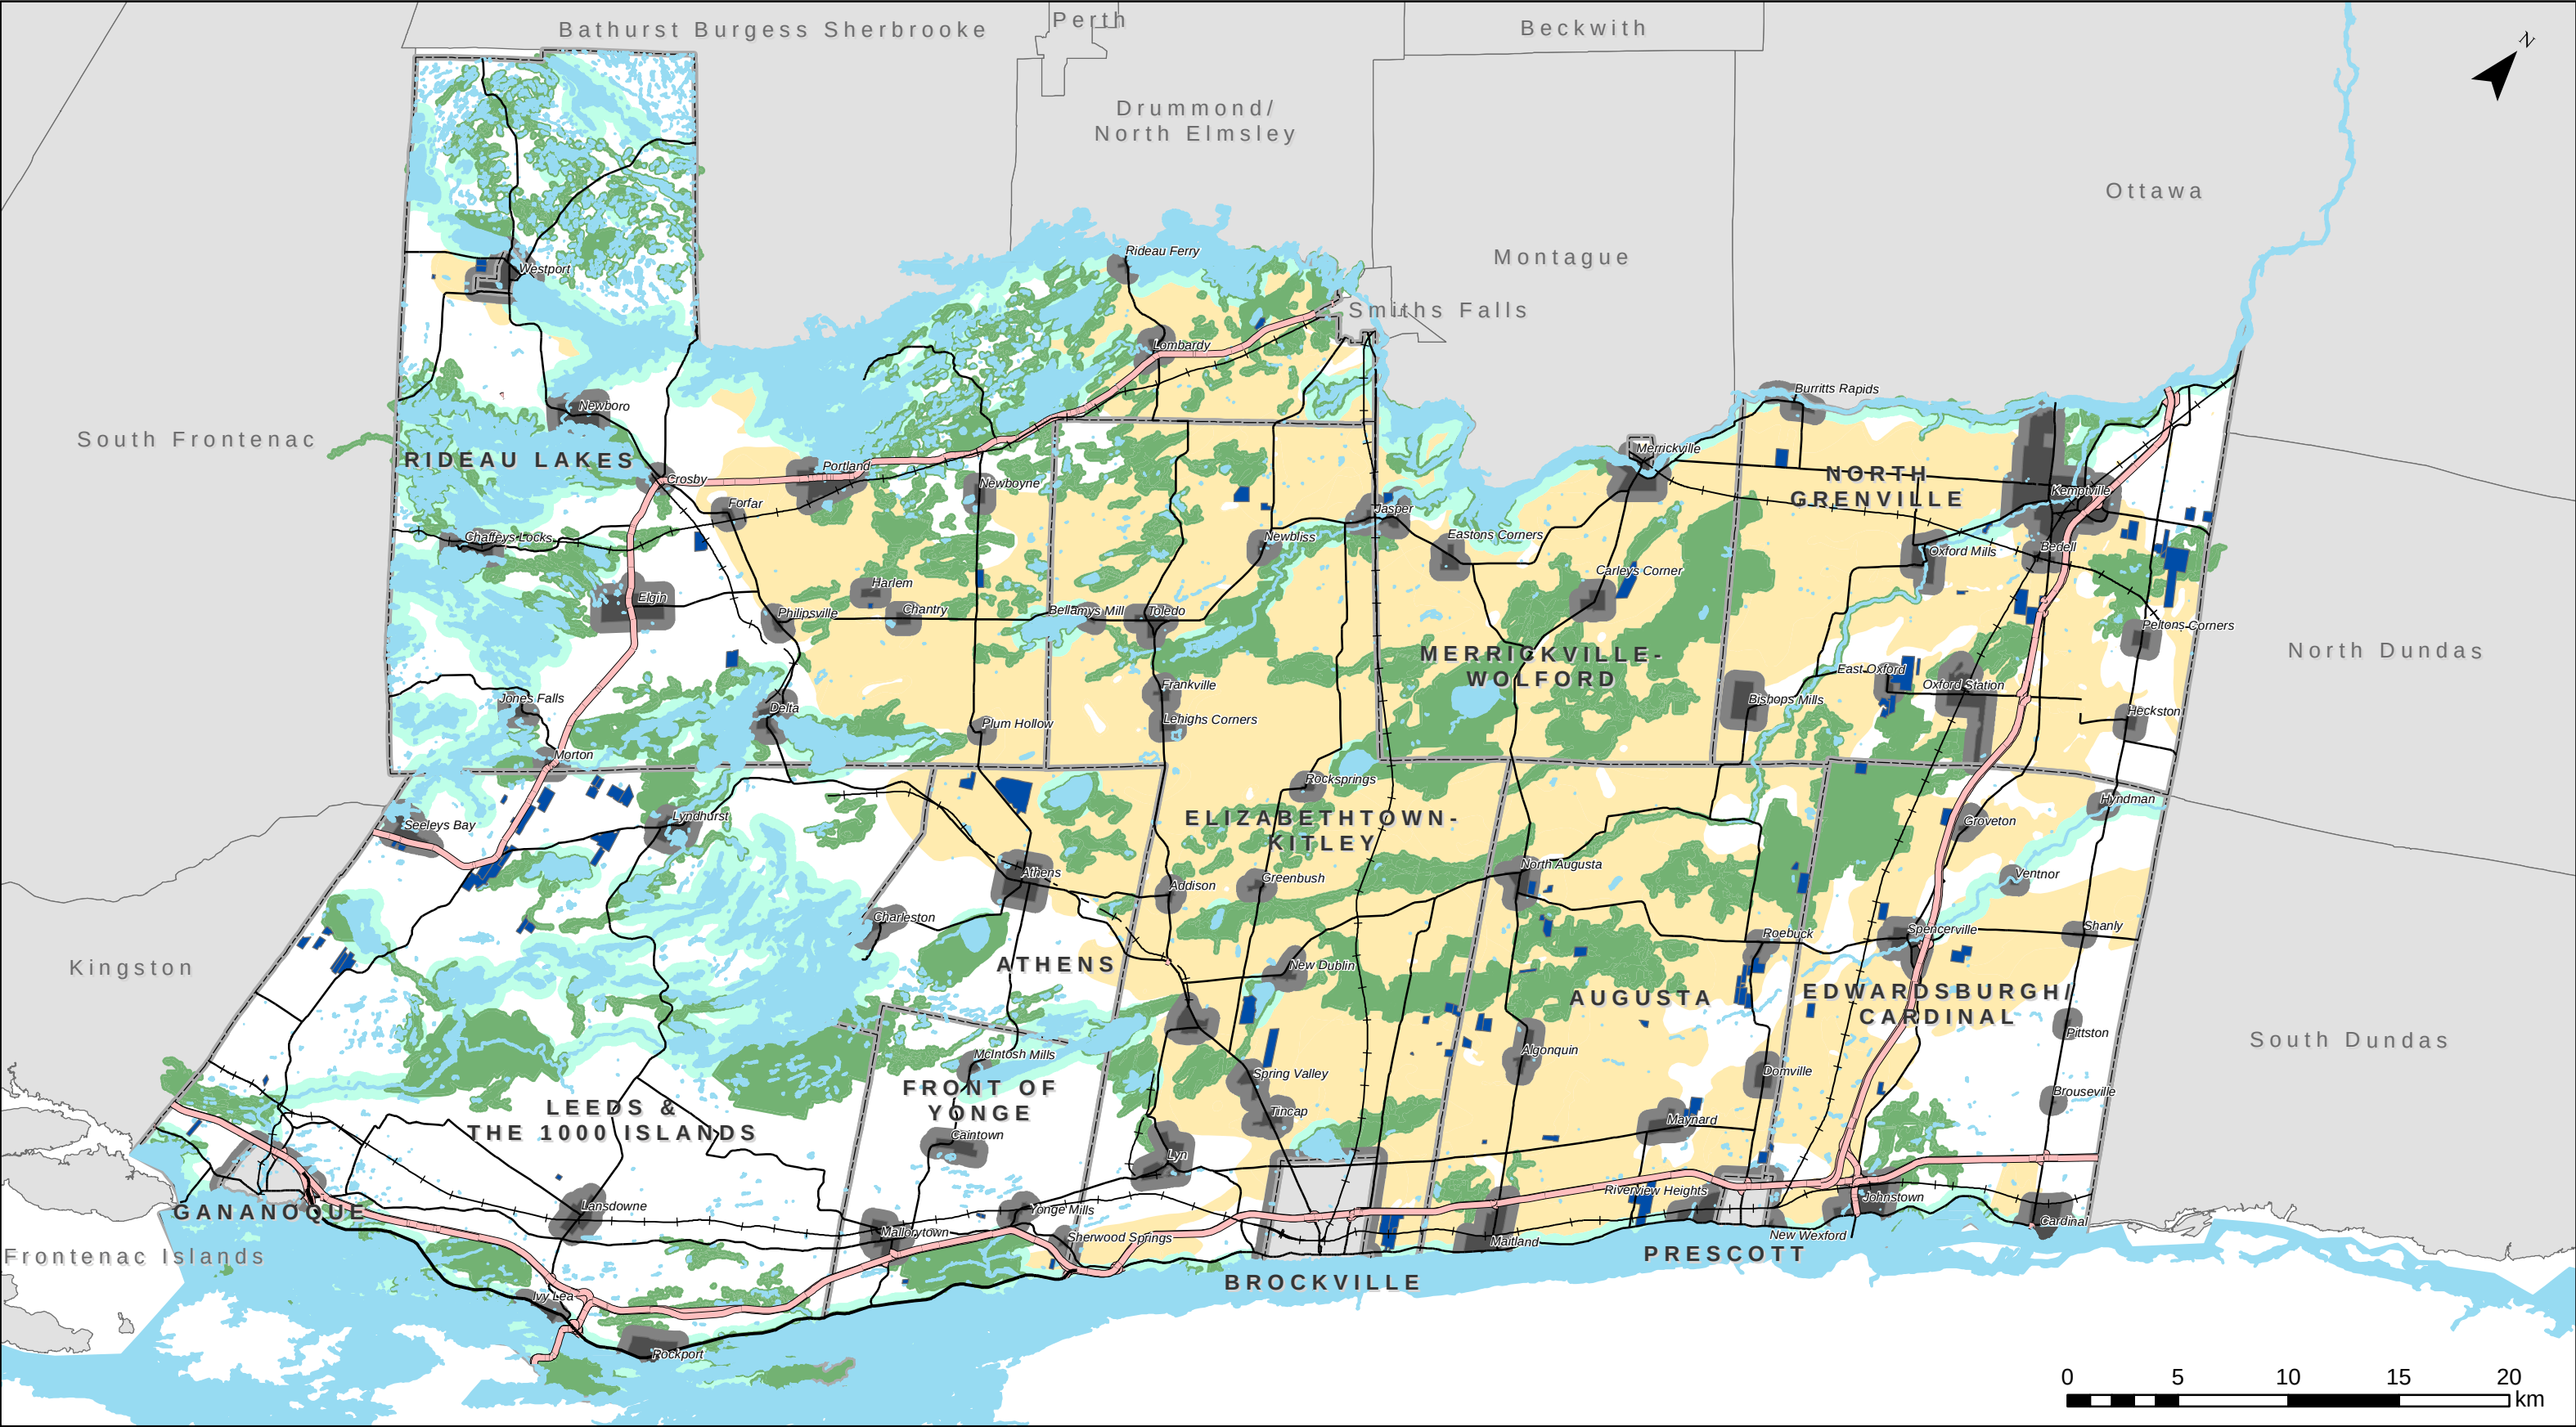

**United Counties of Leeds and Grenville
Mineral Aggregate Resource Study
Bedrock Constraints**

- Bedrock Resource
(With 8m or less
drift thickness)
- Pit/Quarry
- Constraints**

PSW/ANSI including 120 metre buffer

Settlement Area

Settlement Area 500m Buffer

Lake/River

Lake/River 500m Buffer

Bedrock Resource Constraints		
Resource	Total (ha)	Remaining (ha)
Bedrock	176103	112039

